



# OG-300 Solar Water Heating System Certification

No./30004307

Issued: January 07, 2020

This certification is subject to renewal: October 01, 2022

[www.solar-rating.org](http://www.solar-rating.org) | (800) 423-6587 | (562) 699-0543

<b>CERTIFICATION HOLDER:</b> <b>SunEarth, Inc.</b> 8425 Almeria Avenue Fontana, CA 92335 USA <a href="http://www.sunearthinc.com">www.sunearthinc.com</a>	<b>EVALUATION SUBJECT</b> <b>BRAND:</b> Cascade 2 <b>MODEL:</b> C2-40T-50-TLG <b>TYPE:</b> Pumped, Indirect
---	--

## PRODUCT CERTIFICATION SYSTEM:


The ICC-SRCC OG-300 product certification system includes evaluation and development of performance ratings for the solar water heating system in accordance with the SRCC OG-300 Operating Guidelines for Certifying Solar Water Heating Systems, as established in the ICC-SRCC Rules for Solar Heating & Cooling Product Listing Reports. The system also involves factory inspections and surveillance of the supplier's quality system.

## COMPLIANCE WITH THE FOLLOWING STANDARD(S):

ICC 900/SRCC Standard 300-2015

## INSTALLATION:

The solar water heating system must be installed in accordance with the manufacturer's published installation instructions. Installation must conform to the requirements of the applicable code and is subject to approval by the code official having jurisdiction. This certification is valid only for a system composed of the components configured as shown in the schematic below:

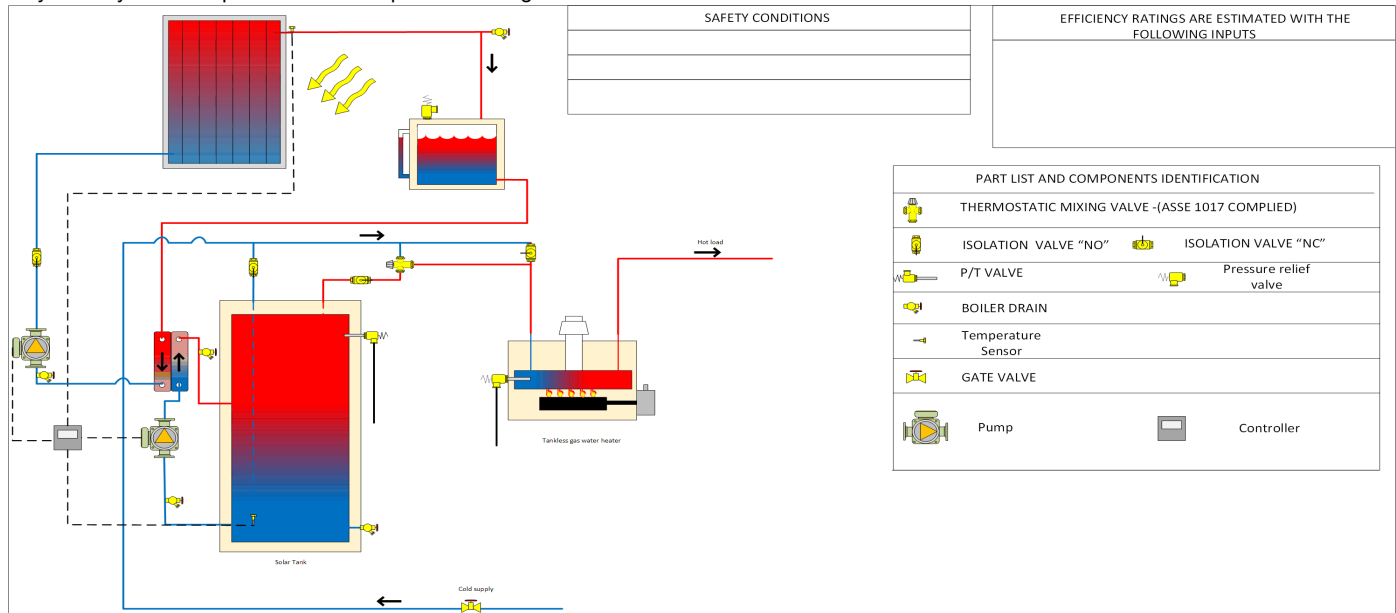

**PARTS LIST:**

Part	Quantity	Evaluated Component
Collector Option 1	1	SunEarth, Inc. Model TRB-40 (OG-100 10001803)
Drainback Tank	1	SolarHot Model DBT 10 SS (38 L volume)
Solar Tank	1	AO Smith Model ENS-50 (189 L volume)

**IDENTIFICATION:**

Certified systems must be identified with the OG-300 certification mark below in accordance with the Rules for Certification Mark and Certificate Use.

**CONDITIONS:**

The certified solar water heating system must comply with the following conditions:

1. Systems must be installed and operated in accordance with the manufacturer's instructions and local code.
2. Systems must include all components installed in the configuration shown in the schematic in the OG-300 certification document.
3. Systems must use one of the OG-100 certified solar collector options from the list above. Where more than one collector is installed in a system, all collectors must be the same model.
4. Systems must utilize heat transfer fluids approved by the manufacturer.
5. Certifications are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use.
6. There is no warranty by ICC-SRCC express or implied, as to any finding or other matter in this certification, or as to any product covered by the certification.

**RATINGS:**

Annual Thermal performance ratings are provided for the system based on computer modeling to standard OG-300 rating conditions and a hot water load of 64.3 gallons per day (243.4 litres per day) at a setpoint of 125 F (51.7 C) for relative comparison. Performance is rated using the following values:

- Solar Fraction (SF): The portion of the total conventional hot water heating load (including tank standby losses) provided by solar energy over a defined period of time.
- Solar Energy Factor (SEF): The energy delivered to the fluid by the system divided by the total electrical and/or gas energy input to the system over a defined period of time.
- Annual Energy Savings (AES): The projected energy savings over a period of one year for the system compared to a baseline tank-type water heater using the same fuel source.

NOTE: Actual thermal performance and energy savings will vary with local conditions, installation details and hot water usage.

Annual rating results are provided for representative locations in various climate zones, as defined by the ASHRAE 169 standard. Color coding of climate zones is consistent across the maps, with the exception of California. There the climate zones are as defined by the CA Energy Commission for use in CA Title 24.

# UNITED STATES OF AMERICA

## OG-300 SOLAR ENERGY FACTOR RATING

Solar Energy Factor (SEF) for the system is provided below for standardized solar irradiance and hot water draws over a single 24-hour period.

SOLAR ENERGY FACTOR (SEF): 2.20

## OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE



USA			
Location	Climate Zone (ASHRAE 169)*	Solar Fraction (SF <sub>A</sub> )	Annual Energy Savings (kWh)
AK - Anchorage	7	0.45	3580
AZ - Phoenix	2B	0.87	4740
CO - Denver	5B	0.73	5020
FL - Tampa	2A	0.82	4370
GA - Atlanta	3A	0.73	4500
MA - Boston	5A	0.63	4310
MO - St Louis	4A	0.67	4380
MT - Helena	6B	0.61	4530
TX - Dallas-Fort Worth	3A	0.77	4480
WA - Seattle	4C	0.57	3860
WI - Milwaukee	6A	0.60	4310

\*Climate zones are as established in ANSI/ASHRAE 169, Climatic Data for Building Design Standards.

# STATE OF CALIFORNIA

## OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in the state of California corresponding to building climate zones as established by the California Energy Commission (CEC) is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below.



California			
Location	CA Climate Zone**	Solar Fraction (SF <sub>A</sub> )	Annual Energy Savings (kWh)
CA - Climate Zone 1	7	0.61	4180
CA - Climate Zone 2	6B	0.74	4750
CA - Climate Zone 3	3C	0.74	4810
CA - Climate Zone 4	4C	0.77	4870
CA - Climate Zone 5	5C	0.78	5070
CA - Climate Zone 6	3B	0.81	4810
CA - Climate Zone 7	3B	0.80	4800
CA - Climate Zone 8	3B	0.82	4940
CA - Climate Zone 9	3B	0.80	4900
CA - Climate Zone 10	3B	0.82	4910
CA - Climate Zone 11	3B	0.75	4530
CA - Climate Zone 12	3B	0.76	4680
CA - Climate Zone 13	3B	0.78	4730
CA - Climate Zone 14	3B	0.85	4920
CA - Climate Zone 15	3B	0.88	4620
CA - Climate Zone 16	7	0.70	4770

\*\* California Building Climate Zones and representative cities are established by the California Energy Commission for use in the CA Title 24 Energy Efficiency Standards.

# HAWAIIAN ISLANDS

## OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in the Hawaiian Islands corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below.



Hawaii			
Location	Climate Zone (ASHRAE 169)*	Solar Fraction (SF <sub>A</sub> )	Annual Energy Savings (kWh)
HI - Hilo	1	0.79	4080
HI - Honolulu	1	0.86	4290
HI - Kahului, Maui Island	1	0.86	4260
HI - Keahole, Hawaii Island	1	0.85	4460
HI - Lihue, Kauai Island	1	0.84	4260
HI - Ho'olehua, Molokai Island	1	0.87	4300

\*Climate zones are as established in ANSI/ASHRAE 169, Climatic Data for Building Design Standards.

# CANADA

## CANADA SINGLE DAY RATING

The Canada Single Day Rating below provides annual estimated energy savings determined using computer modeling based on the standard day specified in the CAN/CSA F379 SERIES-09 (R2013) standard for a 300 litre/day hot water draw.

Baseline energy savings for single-tank electric and gas tank-type water heaters (with no solar input) are -1.11 and -4.83 GJ/year, respectively.

Negative values are indicative of the difference between the energy input to the water heater and the energy delivered to the load, or the sum of the parasitic and standby losses. Therefore, a SWH system with a rating of zero is one where the solar energy input to the system offsets all of the standby and parasitic losses. If the solar contribution in a single-tank system is smaller than the parasitic and stand-by losses, the system will have a negative rating.

<b>ESTIMATED ENERGY SAVINGS (GJ/year for 300 L/day (80 gal/day) hot water load):</b>	None
--	------

## OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in Canada corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below. The local annual ratings are provided for a 243 L/day (64.3 gal/day) hot water load.



Canada			
Location	Climate Zone (ASHRAE 169)*	Solar Fraction (SF <sub>A</sub> )	Annual Energy Savings (kWh)
Edmonton, Alberta	5	0.59	4620
Halifax Nova Scotia, Canada	7A	0.55	3970
Thunder Bay, Ontario, Canada		0.60	4320
Quebec City, Quebec	5	0.57	4350
Winnipeg, Manitoba	7A	0.58	4600
Calgary, Alberta	7A	0.61	4730
Vancouver, British Columbia	7	0.57	3980

\*Climate zones are as established in ANSI/ASHRAE 169, Climatic Data for Building Design Standards.

# CENTRAL AMERICA AND CARIBBEAN REGION

## OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in Central America and the Caribbean region corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below.



Carribean and Central America			
Location	Climate Zone (ASHRAE 169)*	Solar Fraction (SF <sub>A</sub> )	Annual Energy Savings (kWh)
Barbados - Christ Church	1	0.91	4390
Costa Rica - San Jose	1	0.85	5810
Jamaica - Kingston	1	0.91	4430
Mexico - Monterrey	2	0.71	4100
MEX - Mexico City	2	0.74	5040
BLZ - Belize	1	0.85	4120
PR - San Juan	1	0.87	4240

\*Climate zones are as established in ANSI/ASHRAE 169, Climatic Data for Building Design Standards.